
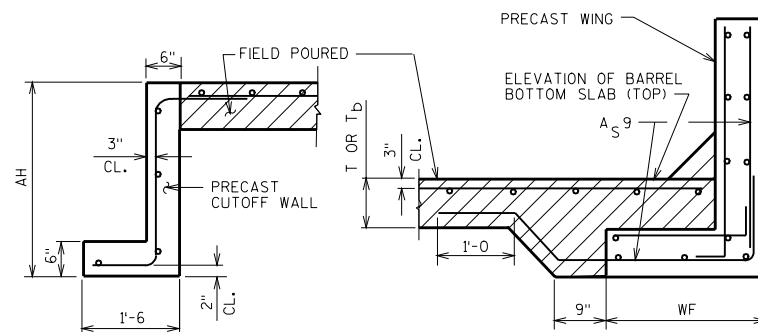


PRECAST ELEMENTS MAY BE POURED IN PLACE AT THE OPTION OF THE CONTRACTOR.

[illegible]

SPAN (S)	A _S 10 BARS			A _S 11 IN. ² / FT.	A _S 12 IN. ² / FT.		
	SKEW				SKEW		
	0°-15°	16°-30°	31°-45°		0°-15°	16°-30°	31°-45°
6'-0"	4 #6	4 #6	4 #7	.35	.17	.17	.17
7'-0"	4 #6	4 #7	4 #7	.35	.17	.17	.19
8'-0"	4 #6	4 #7	4 #8	.42	.17	.19	.24
10'-0"	4 #7	4 #8	4 #8	.48	.19	.24	.24

RISE(R)	A ₉ IN. ² /FT	WF
4'-0	.19	2'-6
6'-0	.24	3'-6
8'-0	.31	4'-0
10'-0	.34	4'-9

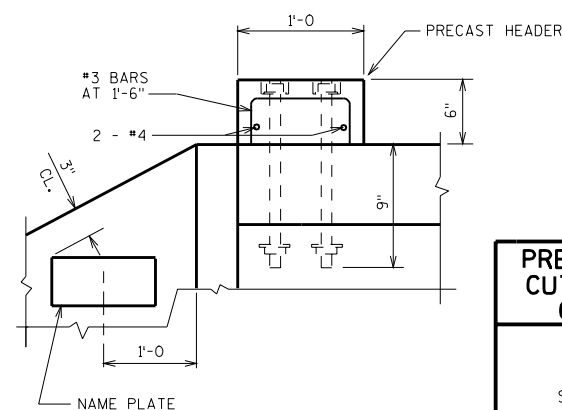

DATE:	3/99
-------	------